


EXHAUST FAN, 34" DIA
3 HP, 13965 CFM @ 0.5" SP
UL APPROVED

MANUFACTURED IN COMPLIANCE WITH NFPA 33, OSHA, NEC,
AND BOCA GUIDELINES

NOTE;
CONTRACTOR TO VERIFY ALL DIMENSIONS IN FIELD AND
REPORT ANY DISCREPANCIES TO ENGINEER PRIOR TO
STARTING WORK

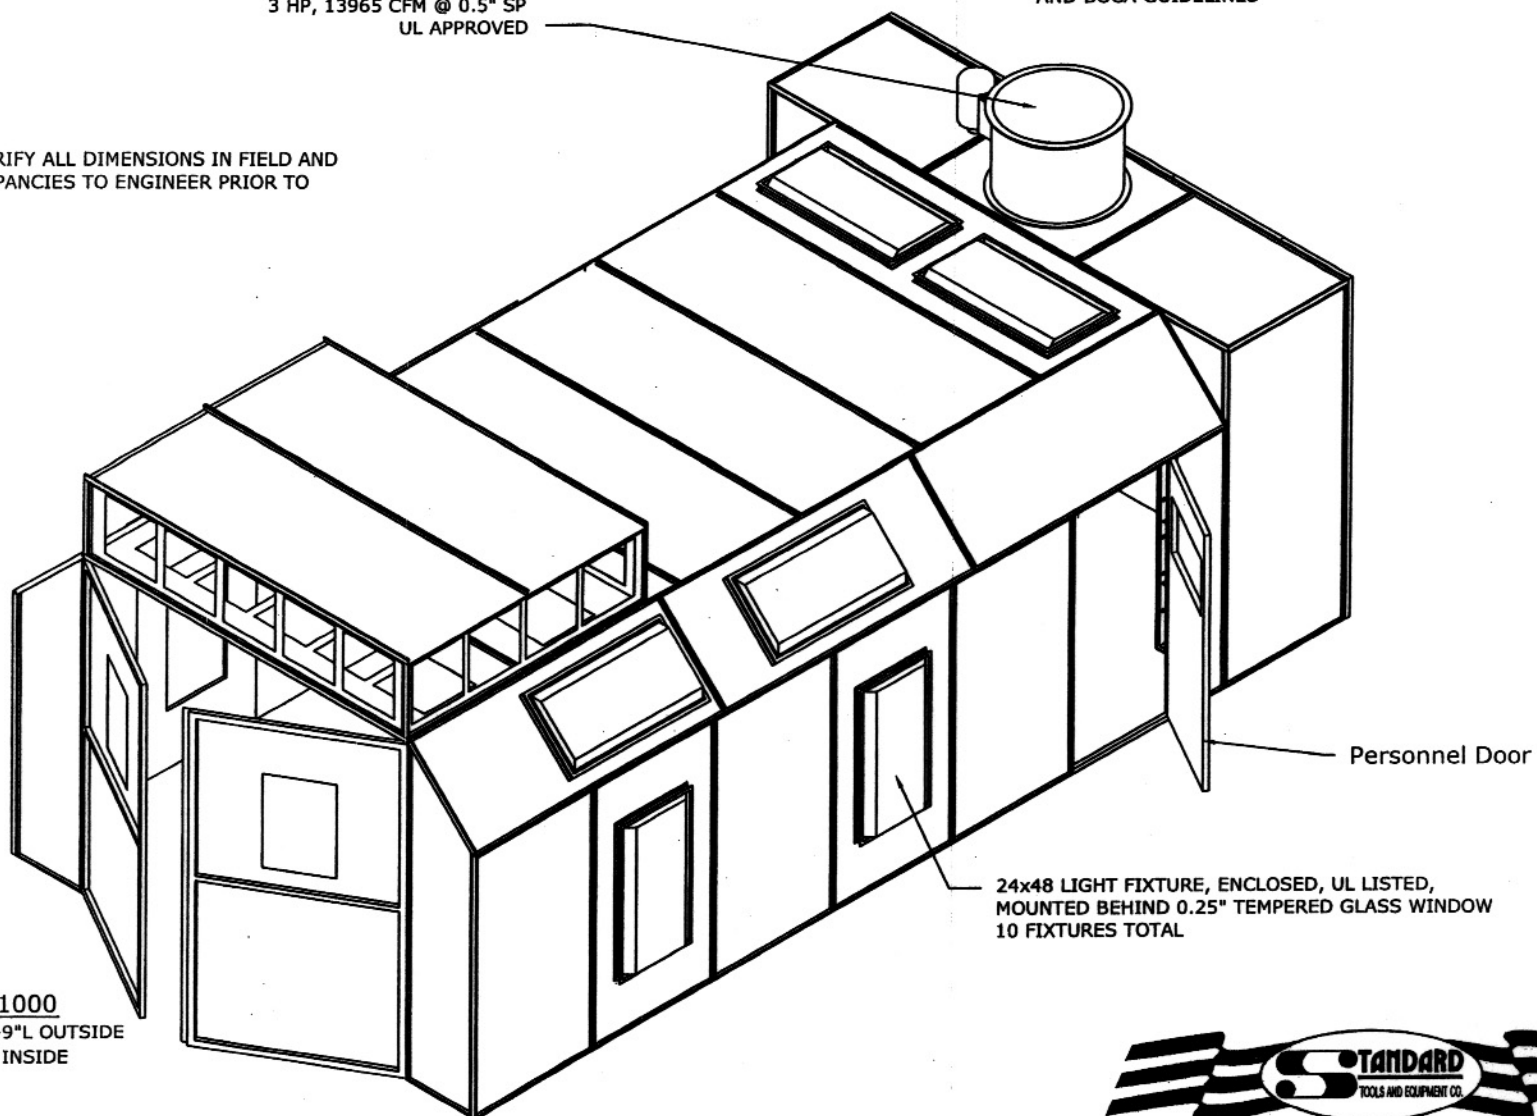

SEMI-DOWN DRAFT-1000
14'-3"W x 11'-1-1/2"H x 26'-9"L OUTSIDE
14'-0"W x 9'-0"H x 26'-6"L INSIDE

NOTES:

- ALL MATERIALS OF CONSTRUCTION ARE NON-COMBUSTIBLE.
- ALL PANELS ARE 18 GA. GALV SHEET STEEL.
- WINDOWS ARE 1/4" TEMPERED GLASS.
- LIGHT FIXTURES ARE ENCLOSED 2x4 FLORESCENT LAYIN TYPE, UL APPROVED, MOUNTED BEHIND GLASS WINDOW.
- FAN IS TUBEAXIAL, ALUMINUM BLADE WITH DRIVE BELT IN ENCLOSED SHROUD, UL APPROVED.



Greensboro, NC 27405
Ph - 1-800-451-2425

| | | | |
|-----------|-------------------|------|----------|
| title | SD-1000 SH 1 OF 2 | | |
| part no | SD-1000 | | |
| order no | - | | |
| drawn by | MBOWLES | date | 11-06-03 |
| file name | XXXX | rev | A |